

Test Report

FOR: **Accessible Products Company**
Tempe, AZ

Sound Absorption
RAL-A16-216

CONDUCTED: 2016-09-08

Page 1 of 7

ON: TechLite Round Hanging Baffles

TEST METHOD

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-09a: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-05(2012): "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measuring procedure and room qualifications is available upon request.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as TechLite Round Hanging Baffles. A full internal inspection performed on the test specimen by Riverbank personnel verified the manufacturer's description.

Detail of material

Specimen Name: TechLite Round Hanging Baffle (Light Grey)
Manufacturer: TechLite Acoustics
Quantity: 31
Length: 609.6 mm (24 in.)
Unit Exposed Surface Area: 0.33 m² (3.57 ft²) (*includes faces*)
Diameter: 153.87 mm (6.058 in.)
Average Unit Weight: 0.10 kg (0.23 lbs.)
Overall Weight: 3.18 kg (7.00 lbs.)
Overall Treated Area: 9.54 m² (102.66 ft²)



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

Test Report

Accessible Products Company
2016-09-08

RAL-A16-216
Page 2 of 7

Test Environment

Volume: 292.0 m³ (10,311.0 ft³)
Temperature: 22.9±0.0°C (73.2±0.1°F) (Requirement: ≥10° C and ≤ 5° C change)
Humidity: 61.2±0.2% (Requirement: ≥40% RH and ≤ 5% change)
Barometric Pressure: 98.4 kPa. (Requirement not defined)

Each sound absorbing unit had an absorptive area (all exposed surfaces) of 0.33 m² (3.57 ft²). The total absorptive area (all exposed surfaces) of all sound-absorbing units was 10.28 m² (110.64 ft²). The array of units covered 9.54 m² (102.6 ft²) of chamber floor surface (total treated area).

MOUNTING METHOD

Type J Mounting: The specimen is an array of spaced sound absorbing baffles suspended from a cable approximately 1.52 m (60.0 in.) above the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The baffles were evenly distributed in four rows four units each. Baffles were spaced 305 mm (12 in.) apart. Rows were spaced 610 mm (24 in.) apart.



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

Test Report

Accessible Products Company
2016-09-08

RAL-A16-216
Page 3 of 7



Figure 1 - Specimen mounted in the test chamber.



Figure 2 - Detail of the test specimen.



NVLAP LAB CODE 100227-0

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL. THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

Test Report

Accessible Products Company
2016-09-08

RAL-A16-216
Page 4 of 7

TEST RESULTS

Note: There is currently no standardized method for calculating Absorption Coefficients from spaced object absorbers. The sound absorption performance of spaced object absorbers should not be compared directly with specimens tested as a single rectangular area (e.g. mounting types A, E, etc.).

1/3 Octave Center

Frequency (Hz)	Total Absorption (SI) (m ²)	Total Absorption (IP) (Sabins)	Absorption (Sabins/Unit)
100	1.09	11.78	0.38
** 125	0.82	8.86	0.29
160	1.53	16.46	0.53
200	2.05	22.06	0.71
** 250	2.41	25.89	0.84
315	4.58	49.25	1.59
400	6.05	65.10	2.10
** 500	8.25	88.82	2.87
630	9.24	99.45	3.21
800	10.66	114.73	3.70
** 1000	11.06	119.03	3.84
1250	11.28	121.42	3.92
1600	11.39	122.60	3.95
** 2000	11.23	120.92	3.90
2500	11.01	118.50	3.82
3150	10.57	113.77	3.67
** 4000	10.26	110.46	3.56
5000	10.25	110.38	3.56

Tested by  Report by  Approved by 
 Marc Sciaky Miles Possing Eric P. Wolfram
 Experimentalist Acoustical Test Engineer Laboratory Manager



NVLAP LAB CODE I00227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An **ALION** Technical Center

RIVERBANK.ALIONSCIENCE.COM


FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Accessible Products Company
2016-09-08

RAL-A16-216
Page 5 of 7

SOUND ABSORPTION REPORT
TechLite Round Hanging Baffles

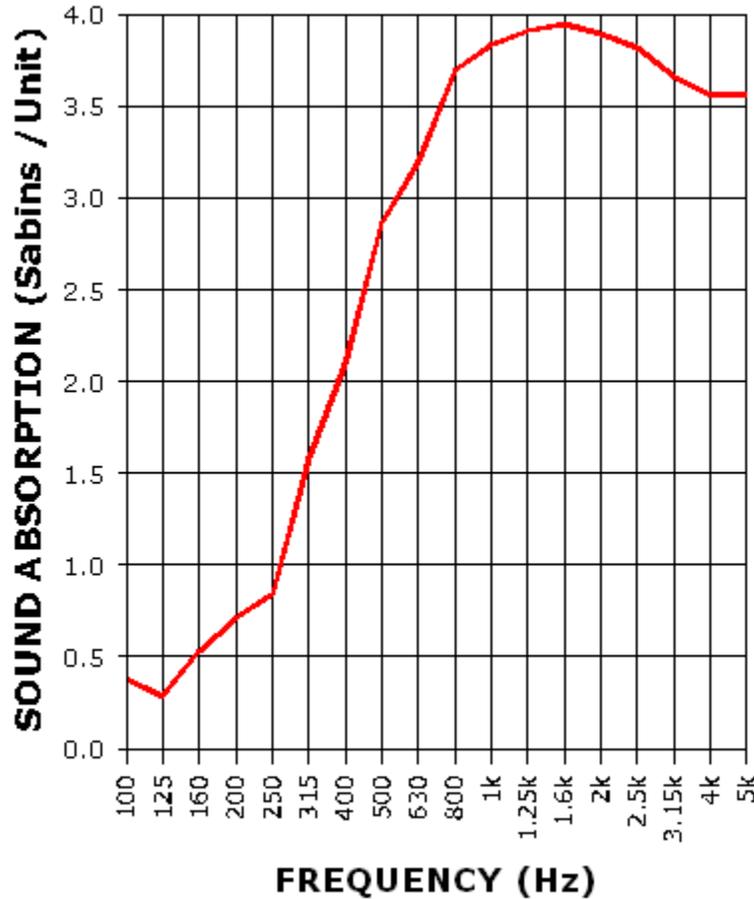

NVLAP LAB CODE 100227-0

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

Test Report

Accessible Products Company
2016-09-08

RAL-A16-216
Page 6 of 7

APPENDIX A: Extended Frequency Range Data

Specimen: TechLite Round Hanging Baffles (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-09a, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Sabins per Unit
31.5	1.33	0.04
40	-5.36	-0.17
50	2.25	0.07
63	-5.64	-0.18
80	6.35	0.20
<hr/>		
100	11.78	0.38
125	8.86	0.29
160	16.46	0.53
200	22.06	0.71
250	25.89	0.84
315	49.25	1.59
400	65.10	2.10
500	88.82	2.87
630	99.45	3.21
800	114.73	3.70
1000	119.03	3.84
1250	121.42	3.92
1600	122.60	3.95
2000	120.92	3.90
2500	118.50	3.82
3150	113.77	3.67
4000	110.46	3.56
5000	110.38	3.56
<hr/>		
6300	109.21	3.52
8000	105.18	3.39
10000	105.34	3.40
12500	105.72	3.41



NVLAP LAB CODE I00227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Accessible Products Company
2016-09-08

RAL-A16-216
Page 7 of 7

APPENDIX B: Instruments of Traceability

Specimen: TechLite Round Hanging Baffles (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
Bruel & Kjaer Pulse Analyzer - System3	Type 3560-C	2647140	2016-04-12	2017-04-12
Bruel & Kjaer Mic And Preamp C	Type 4943-B-001	2311439	2016-03-17	2017-03-17
Bruel & Kjaer Pistonphone	Type 4228	2781248	2016-07-25	2017-07-25
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP-PRHTemp2000	N11105	2015-09-30	2016-09-30

END



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

FOR: **Accessible Products Company**
Tempe, AZ

Report Referenced: **RAL-A16-216**
Page 1 of 2

CONDUCTED: 2016-09-08

ON: TechLite Round Hanging Baffles (See Full Test Report for Details)

Appendix C to ASTM C423 Sound Absorption Test

Non-standard calculation of equivalent NRC Rating and Absorption Coefficients from spaced absorbers.

At this time ASTM C423 does not provide a standard method for determining absorption coefficients of spaced object absorbers. Tests of a set of sound absorbing objects spaced apart from each other will yield higher absorption rates than a specimen joined together as a single patch (A-Mount or E-Mount). For this reason it is unfair to provide NRC or absorption coefficient ratings for specimens that consist of a spaced set of absorbers. Despite this, the architectural industry has expressed great demand for a simple "single number" rating for these treatments. Likewise, acoustical consultants desire equivalent absorption coefficient data for use in acoustical modeling programs. The following is an attempt to appease these demands until ASTM develops a standard method for calculation. Several alternate non-standard calculation methods are provided. Riverbank Acoustical Laboratories prefers method 1.

Method 1) Apparent Sound Absorption Coefficient calculated from total test surface area covered.

The total sound absorption yielded by the specimen is divided by the total surface area of the test surface covered by the suspended baffles, including intermediate spaces. The baffle rigging covered 9.54 m² (102.6 ft²) of horizontal test surface area. Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-09a. This may be the most accurate method for comparing baffle arrays to ceiling tile products. In acoustical modeling applications, the apparent sound absorption coefficient data can be assigned to a single horizontal surface or plane in acoustical modeling software for approximation of baffle array performance (assuming baffle spacing is similar to that tested).

Method 2) Apparent Sound Absorption Coefficient calculated from total exposed surface area of specimen.

The total sound absorption yielded by the specimen is divided by the total surface area of all exposed specimen faces (0.33 m² (3.57 ft²) per baffle x 31 baffles = 10.28 m² (110.64 ft²) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-09a. This method shows the actual absorption occurring at the exposed surfaces, but does not provide a fair comparison with materials mounted as a uniform patch (in A-mount or E-mount).

FOR: Accessible Products Company
CONDUCTED: 2016-09-08

Report Referenced: **RAL-A16-216**

Page 2 of 2

Appendix D: Data Note: See full test report for details of mounting position, spacing and configuration as these parameters greatly affect sound absorption performance.

Specimen Absorption (US)			Method 1	Method 2
Freq. (Hz)	Sabins	Sabins/Unit	Apparent Abs. Coefficient From Total Coverage Area	Apparent Abs. Coefficient From Total Exposed Surface Area
31.5	1.33	0.04	0.01	0.01
40	-5.36	-0.17	-0.05	-0.05
50	2.25	0.07	0.02	0.02
63	-5.64	-0.18	-0.05	-0.05
80	6.35	0.20	0.06	0.06
100	11.78	0.38	0.11	0.11
125	8.86	0.29	0.09	0.08
160	16.46	0.53	0.16	0.15
200	22.06	0.71	0.21	0.20
250	25.89	0.84	0.25	0.23
315	49.25	1.59	0.48	0.45
400	65.10	2.10	0.63	0.59
500	88.82	2.87	0.87	0.80
630	99.45	3.21	0.97	0.90
800	114.73	3.70	1.12	1.04
1,000	119.03	3.84	1.16	1.08
1,250	121.42	3.92	1.18	1.10
1,600	122.60	3.95	1.19	1.11
2,000	120.92	3.90	1.18	1.09
2,500	118.50	3.82	1.15	1.07
3,150	113.77	3.67	1.11	1.03
4,000	110.46	3.56	1.08	1.00
5,000	110.38	3.56	1.08	1.00
6,300	109.21	3.52	1.06	0.99
8,000	105.18	3.39	1.02	0.95
10,000	105.34	3.40	1.03	0.95
12,500	105.72	3.41	1.03	0.96
Apparent NRC:			0.85	0.80
Apparent SAA:			0.87	0.80

Prepared by 
Miles Possing
Acoustical Test Engineer